

IEC**IECEE**

TM

Ref. Certif. No.

CN60492

**IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT
(IECEE) CB SCHEME****CB TEST CERTIFICATE**

Product

Switch-disconnector

Name and address of the applicant

NOARK Electrics (Shanghai) Co., Ltd.
No.3857 Sixian Road, Songjiang District, Shanghai,
P.R.China

Name and address of the manufacturer

NOARK Electrics (Shanghai) Co., Ltd.
No.3857 Sixian Road, Songjiang District, Shanghai,
P.R.China

Name and address of the factory

*Note: When more than one factory, please report on page 2*NOARK Electrics (Shanghai) Co., Ltd.
No.3857 Sixian Road, Songjiang District, Shanghai,
P.R.China

Ratings and principal characteristics

See the Appendix

Trademark (if any)

NOARK

Customer's Testing Facility (CTF) Stage used

N/A

Model / Type Ref.

Ex9ASD-4000DC, ExASD E 4000DC;

Additional information (if necessary may also be
reported on page 2)A sample of the product was tested and found
to be in conformity with

IEC 60947-1:2020; IEC 60947-3:2020

As shown in the Test Report Ref. No. which
forms part of this Certificate

03601-A-23CB0055-S

This CB Test Certificate is issued by the National Certification Body

CHINA QUALITY CERTIFICATION CENTRE

Section 9, No. 188 Nansihuan Xilu, Beijing 100070 P. R. China

Tel: +86-10-83886666 Fax: +86-10-83886282

website: <http://www.cqc.com.cn>

Date: Jul.06,2023

Signature:

Xie ZhaoXu



Ex9ASD-4000DC, ExASD E 4000DC

Ui:1600V, Uimp:12kV; Ith=Ie,

Ue: DC750V/1000V(3P appearance), DC1250V/1500V(4P appearance);

Ie: 1250A, 1600A, 2000A, 2500A, 3200A, 4000A;

Icw:100kA/1s; Icm(peak value):100kA;

Utilization category:DC-22A, DC-23A, DC-PV2;


Degree of protection: IP30(Operative surface).

Auxiliary contact(1NO1NC~12NO12NC):Ui:500V; Uimp:6kV; Ith:5A;

AC-15:Ue/Ie:AC110V/5A, AC240V/4A, AC415V/2A;

DC-13:Ue/Ie:DC110V/0.25A, DC220V/0.25A.

DC connection mode:

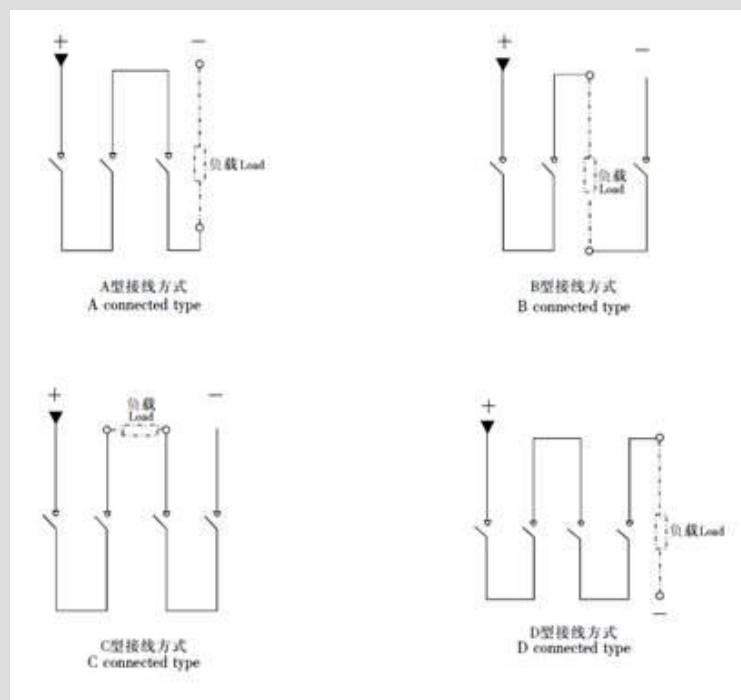

Additional information (if necessary)

Date:

Jul.06,2023

Signature:

谢肇煦
Xie ZhaoXu